

CRESTA LOMA SYSTEM
0.27 ppm/18 ppm

JAMES TRIPP SYSTEM
0.26 ppm/29 ppm


MOORE-HERB JOHNSON
0.29 ppm/28 ppm

HARDY SYSTEM
0.21 ppm/14 ppm

HERB JOHNSON SYSTEM
0.26 ppm/29 ppm

LAS PALMAS SYSTEM
0.34 ppm/19 ppm

MAGEE/LA CHOLLA SYSTEM
0.32 ppm/24 ppm

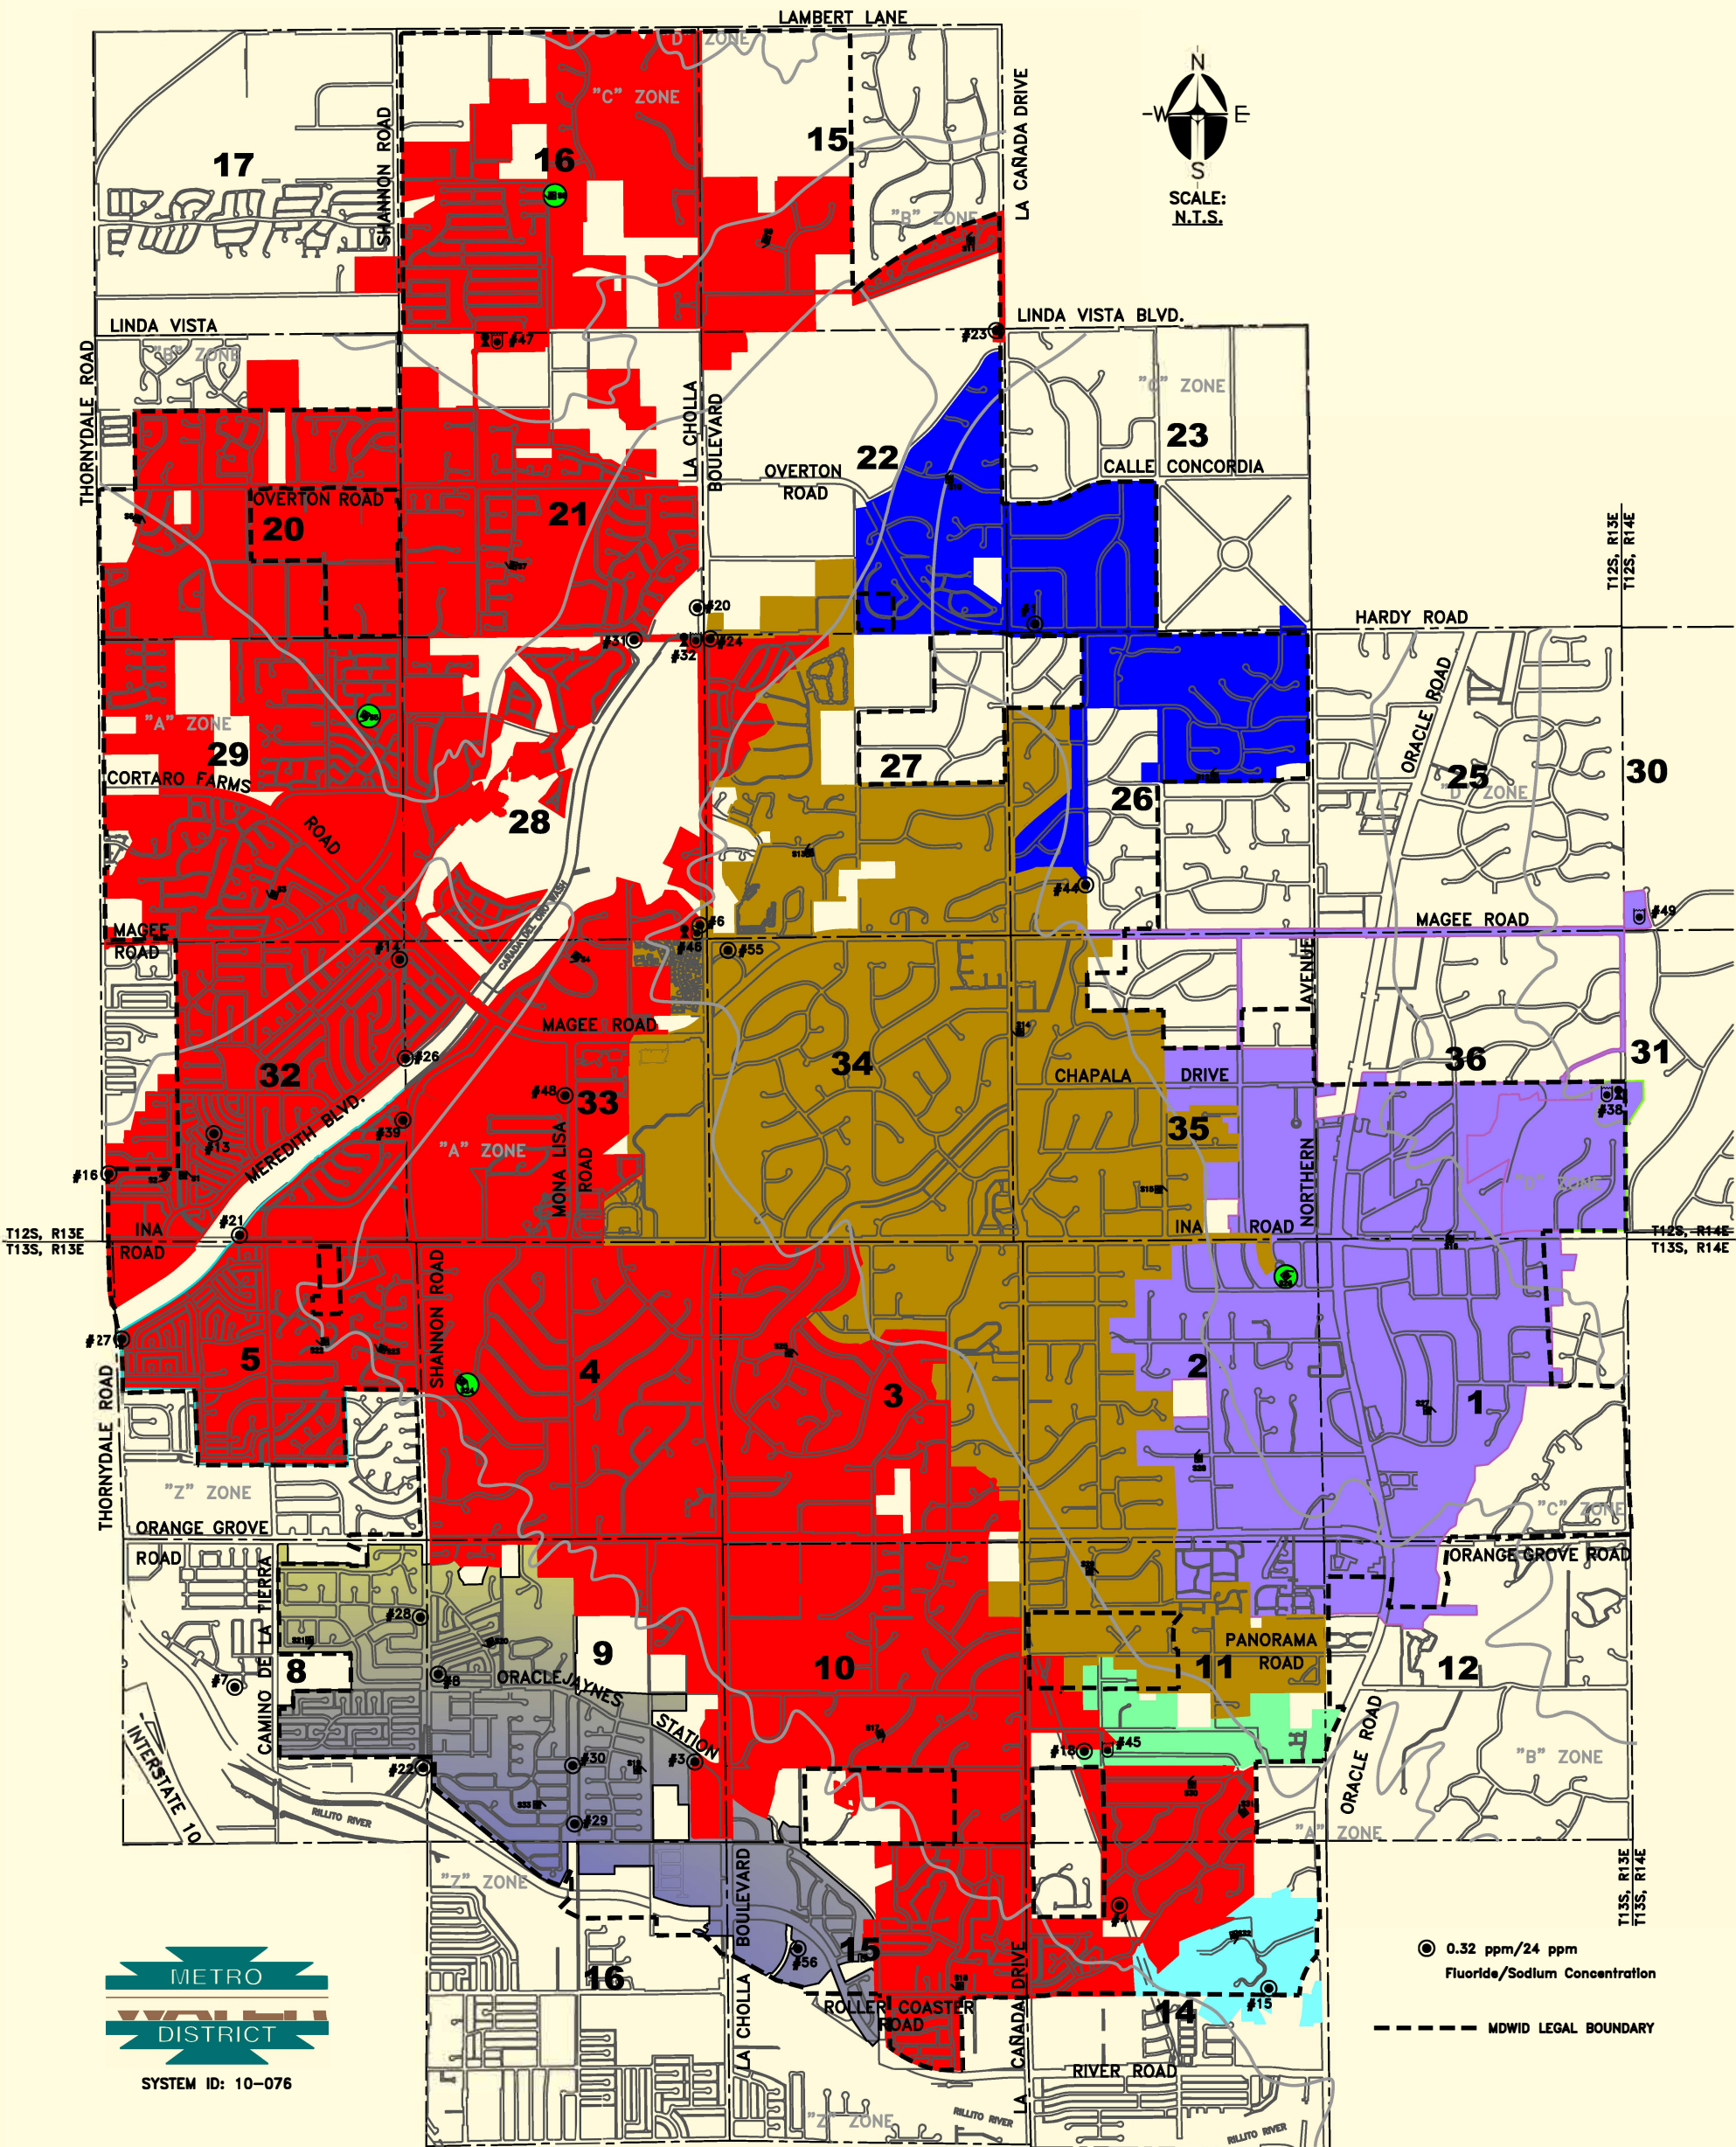

2025 METRO-MAIN FLUORIDE/SODIUM CONCENTRATIONS